

920.326.5193 Randolph
608.251.4318 Madison
800.321.5193 Toll Free
563.203.0182 Cresco, IA
920.326.5209 Fax



Well Drilling, Inc.
"Well Worth It"

P.O. Box 150
Randolph, WI 53956

February 17, 2014

RECEIVED-DNR

Dave Johnson
Wisconsin Department of Natural Resources
Private Water Systems Section
Bureau of Drinking Water and Ground Water
101 S Webster Street
P.O. Box 7921
Madison, WI 53707-7921

FEB 21 2014

DRINKING WATER & GW

RE: High Capacity Well Application for Mark Doudlah, Doudlah Dirt LLC, 10222 North Wilder Road, Evansville, Wisconsin, Town of Porter, Rock County.

Dear Dave:

On behalf of Mark Doudlah, Sam's Well Drilling, Inc., proposes to construct two high-capacity wells on Riley Road. The proposed wells will supply water to an irrigation system, to be erected on the property. The enclosed application is for these high-capacity wells.

There are three other wells on the property at this time. If you have any questions regarding this project, please contact me at (920) 326-5193.

Sincerely,

SAM'S WELL DRILLING, INC.

A handwritten signature in black ink, appearing to read "Jeff Kramer".

Jeff Kramer, P.G.
Hydrogeologist

Agent authorized to submit this application on behalf of the property owner, Mark Doudlah.

www.samswelldrilling.com

*****ASK US ABOUT GEOTHERMAL TO HEAT & COOL YOUR HOME*****

Providing Well Drilling Services For Over 50 Years

RESIDENTIAL, MUNICIPAL, IRRIGATION AND COMMERCIAL WATER WELL DRILLING • WELL INSPECTIONS • WELL ABANDONMENTS

RECEIVED-DNR

FEB 21 2014

DRINKING WATER & GW

High Capacity, School or Wastewater Treatment Plant
Well Approval Application

Form 3300-256 (R 7/05)

Page 1 of 6

Notice: Prior department approval is required for the construction, reconstruction or operation of a high capacity well or system of high capacity wells, a school well or a wastewater treatment plant well in accordance with Section NR 812.09(4)(a), Wisconsin Administrative Code. Personally identifiable information collected on this form, including such data as your name, address and phone number, will be used for management of department programs and is unlikely to be used for other purposes. This information will be addressable under Wisconsin's Open Records Laws, ss. 19.32 - 19.39, Wis. Stats.

Use this form to request an approval for installation of a well or wells on a high capacity property, seek approval to make other changes to a high capacity property or to modify a well on a high capacity property, as required by NR 812.09(4)(a), Wisconsin Administrative Code. Refer to definitions of high capacity well, high capacity property and high capacity well system on page 5.

This form is not intended to be used when seeking approval for construction or modification of wells serving water systems regulated under ch. NR 811, Wis. Adm. Code. Any water system serving 7 or more homes, 10 or more mobile homes, 10 or more apartments, 10 or more condominiums, or 10 or more duplexes is regulated under ch. NR 811, Wis. Adm. Code. See NR 811.01, Wis. Adm. Code for applicability requirements.

Applicant Information

Application Prepared By (Name and Title) JEFF KRAMER / HYDROGEOLOGIST		Company SAM'S WELL DRILLING	
Street Address P.O. Box 150	City RANDOLPH	State WI	ZIP Code 53456
Telephone Number 920-326-5193	Fax Number 920-326-5209	E-Mail Address JEFFK@SAMSWELLDILLING.COM	

Property Ownership Information

Property owner, if different than applicant (Name of Person and Title) MARK DOUDLAH / OWNER		Company DOUDLAH'S DIRT LLC	
Street Address 10222 N WILDER ROAD	City EVANSVILLE	State WI	ZIP Code 53536
Telephone Number 608-490-0925	Fax Number	E-Mail Address MARK.R.DOUDLAH@GMAIL.COM	

Well Operator Information

Well operator if different than owner (Name of Person and Title) MARK DOUDLAH / OWNER		Company DOUDLAH FARMS LLC	
Street Address 10222 N. WILDER ROAD	City EVANSVILLE	State WI	ZIP Code 53536
Telephone Number 608-490-0925	Fax Number	E-Mail Address MARK.R.DOUDLAH@GMAIL.COM	

Property Information

Enter the High Capacity Well File Number below if the property is already a high capacity property. If the property is not designated as a high capacity property at the time of application, enter "NONE." NOTE: Find the file number in upper right hand corner of the most recent high capacity well approval, or use the compact disk of departmental well data that is issued to drillers and pump installers. On the compact disk, see "File location" in red print in "Location" section. File number format is as follows: (1 or 2 digits for county) - (1 digit for well classification) - (1 to 4 digits for assigned property no.).

County ROCK	Town PORTER	High Capacity Well File No.
----------------	----------------	-----------------------------

Submittal Purpose

Check all that apply:

- ☒ Install one or more new wells with a capacity greater than 70 gallons per minute.
- ☐ Install one or more new wells with a capacity less than 70 gallons per minute on a high capacity property.
- ☐ Replace one or more wells with a capacity greater than 70 gallons per minute.
- ☐ Replace one or more wells with a capacity less than 70 gallons per minute on a high capacity property.
- ☐ Reconstruct one or more wells with a capacity greater than 70 gallons per minute.
- ☐ Reconstruct one or more wells with a capacity less than 70 gallons per minute on a high capacity property.
- ☐ Increase pumping rate in one or more wells to a rate greater than previously approved.
- ☐ Request continued operation of high capacity wells after a change in ownership. (No application fee required.)
- ☐ Renew a previous approval that has expired.
- ☐ Well (or wells) will serve a school or wastewater treatment plant. See definitions on page 5.
- ☐ Other, explain _____

Site Status Information

Determine the site status using the internet or the compact disk of departmental well data that is issued to drillers and pump installers and the information supplied by the property owner. Internet address is dnr.wi.gov/org/water/dwg/dws.htm. Enter YES or NO for each of the following questions.

YES NO

☐ ☒ Has the property boundary changed since the most recent high capacity well approval was issued? If the property is not yet a high capacity property, check NO.

☐ ☒ Has there been a change in well ownership since the last approval was written?

If YES, name of current owner:

Date of purchase:

☐ ☒ Has there been a change in well operator since the last approval was written?

If YES, name of current operator:

Date of change:

☐ ☒ Will a proposed well be connected to a plumbing system that is supplied by other sources (other wells, municipal supply, etc.)? If YES, include a schematic drawing showing backflow protection.

☐ ☒ Is a proposed well within 1,200 feet of a landfill? Determine if there are any landfills nearby, using the well information compact disk FIND feature. Enter the township, range and section of the well location. If the well is near a section line, also check the adjacent section or sections.

If YES, list the landfill site ID Number:

OR

Landfill location: (Township/Range/Section)

☐ ☒ Is a proposed well on a property that has a contaminated site? If YES, list the BRRTS (Bureau for Remediation and Redevelopment Tracking System) Number here and specify if the site is open or closed:

☐ Open☐ Closed

☐ ☒ Is a proposed well on a property that has a groundwater use restriction recorded on the deed? If YES, list the BRRTS number, as assigned to the contaminated site by the DNR remediation and redevelopment program:

☐ ☒ Is a proposed well on a property that is listed on the department's registry of closed remediation sites for a groundwater use restriction? See compact disk or internet at maps.dnr.state.wi.us/imf/dnrimf.jsp?site=brrts. If YES, list the BRRTS Number here:

☐ ☒ Is a proposed well to be used for a public water supply system that serves 25 or more people? See definition of a "public water system" in the definitions section on page 5.

☐ ☒ Is a proposed well to be installed within a special casing area? Refer to the list of special casing areas that is published by the department and/or contact the regional DNR office.

☐ ☒ Has the number of wells or pumping capacity in an existing well increased since the most recent high capacity well approval was issued?

☐ ☒ Has the number of wells decreased since the most recent high capacity well approval? If the property is not yet a high capacity property, check NO.

☐ ☒ Is a non-pressurized storage vessel (i.e. reservoir) other than a pond proposed or in use?

☐ ☒ Will the well discharge directly to a storage pond?

☐ ☒ Is a pressurized tank with a capacity greater than 1,000 gallons proposed or in use?

☐ ☒ Is a proposed well within 1,200 feet of a quarry?

☐ ☒ Is a proposed well located in a floodplain or floodway?

☐ ☒ Are any existing well installations on the high capacity property out of compliance with Chapter NR 812, Wisconsin Administrative Code?

☐ ☒ Will the well be used as a source of bottled water?

☐ ☒ Are you seeking a variance to construct a well that has a capacity of less than 70 gallons per minute to low capacity well construction standards?

☐ ☒ Is the property served by a community water system?

Existing Well Information

Enter the following information on all existing wells on the property, if more than four wells, submit additional sheets:

Well Name Assigned by Well Owner (North Well, etc.):	FARM WELL	ELLESPIE WELL	SISTER WELL	
Well Number Assigned by Owner (001, 002, etc.):	001	002	003	
WI Unique Well Number or NA if no number:	NONE	DN251	CQ288	
Permanent DNR High Capacity Well Number or N/A if none:	NA	NA	NA	
Public Water System ID Number, if Public (if not public, NONE):	NONE	NONE	NONE	
Potable or Non-Potable Use:	POTABLE	POTABLE	POTABLE	
Type of Well (Irrigation, Industrial, Residential, etc.):	FARM	RESIDENTIAL	RESIDENTIAL	
Requested Average Water Usage per Day in Gallons:	500	500	500	
Requested Maximum Water Usage per Day in Gallons:	1000	1000	1000	
Seasonal? (April to October, Year Around, etc.):	YEAR ROUND	YEAR ROUND	YEAR ROUND	
Approved Pumping Capacity if Previously Approved (gpm):	NA	NA	NA	
Current Pump Type & Capacity (gpm):	SUBMERSIBLE/15	SUBMERSIBLE/15	SUBMERSIBLE/20	
Proposed Pump Type & Capacity If Change Requested (gpm):	NA	NA	NA	
Pump Discharge Type (Over Top of Casing Seal, Pitless, etc.):	PITLESS	PITLESS	PITLESS	
Discharge Location (Building Pressure Tank, Pond, etc.):	BUILDING PRESSURE TANK	BUILDING PRESSURE TANK	BUILDING PRESSURE TANK	
Height of Well Casing Above Ground in Inches:	12.0"	12.0"	16.0"	
Potential Contaminant Sources and Distance:	BUILDING OVERHANG 200'	BUILDING OVERHANG 300'	BUILDING OVERHANG 400'	
Well Loc: Quarter Quarter Section or Government Lot Number	SE 1/4 of SE 1/4	SW 1/4 of SE 1/4	NE 1/4 of SE 1/4	1/4 of 1/4
Section or French Long Lot No.	8	8	17	
Township:	T 4 N	T 4 N	T 4 N	T N
Range (Select E or W):	R 11 E	R 11 E	R 11 E	R E
Latitude (Degrees and Minutes)	42° 49.350'	42° 49.050'	42° 48.690'	° '
Longitude (Degrees and Minutes)	089° 13.272'	089° 13.260'	089° 13.284'	° '
GPS Map Datum (WGS84, WTM91, etc.)	GPS008	GPS008	GPS008	
Include as much of the following information as practical for wells that do not have well construction records attached to the application, however if the well construction record is attached, applicant may leave the following rows blank.				
Date of Construction:	UNKNOWN	7/11/91	8/21/01	
Drilled by (Name of Drilling Firm):	UNKNOWN	GOVERT	BERKHOLTZ	
Drilling Method(s) (Rotary, Percussion, Etc.):	UNKNOWN	ROTARY	ROTARY	
Well Depth in Feet:	UNKNOWN	145	265	
Upper Enlarged Drillhole Diameter in Inches and Depth in Feet:	UNKNOWN	9.0" inches, 112.0' feet	9.3" inches, 59.0' feet 6.0" inches, 185.0' feet	inches, feet
Lower Drillhole Diameter in Inches and Depth in Feet:	UNKNOWN	6.0" inches, 145.0' feet	5.0" inches, 265.0' feet	inches, feet
Well Casing Diameter in Inches and Depth in Feet:	6.0" UNKNOWN	6.0" inches, 112.0' feet	6.0" inches, 59.0' feet 5.0" inches, 185.0' feet	inches, feet
Well Casing Material and Wall Thickness:	STEEL / .280	STEEL / .280	STEEL 6.0" .280 STEEL 5.0" .258	
Annular Space Material Between Casing and Drillhole Wall:	UNKNOWN	MUD AND CUTTING S	MUD AND CUTTING S	
Is There a Well Screen (Y or N) If so, Screen Material?:	UNKNOWN	N	N	

Proposed Well Information

Enter the following information on all proposed wells on the property, if more than two wells or alternate construction, submit additional sheets:

Well Name Assigned by Well Owner (North Well, etc.):	NORTH WILDER		SOUTH WILDER	
Well Number Assigned by Owner (001, 002, etc.):	001		002	
Well Loc: Quarter Quarter Section or French Long Lot Number	SW 1/4 of SE 1/4 of Section 8		NE 1/4 of SE 1/4 of Section 17	
or Government Lot Number				
Township & Range (Select E or W)	T 4 N, R 11	<input checked="" type="checkbox"/> E <input type="checkbox"/> W	T 4 N, R 11	<input checked="" type="checkbox"/> E <input type="checkbox"/> W
Latitude (Degrees and Minutes)	42 ° 48.596		42 ° 48.471	
Longitude (Degrees and Minutes)	089 ° 12.597		089 ° 12.949	
GPS Map Datum (WGS84, WTM91, etc.)	GPRC08		GPRC08	
Type of Well (Irrigation, Industrial, Residential, etc.):	Type: IRRIGATION	<input checked="" type="checkbox"/> Potable <input type="checkbox"/> Non-Potable	Type: IRRIGATION	<input checked="" type="checkbox"/> Potable <input type="checkbox"/> Non-Potable
Drilling Method(s) (Rotary, Percussion, etc.):	ROTARY		ROTARY	
Anticipated Geological Materials and Depths that Are Expected During Drilling:				
Material and Depth Interval:	SAND+GRAVEL from 0' to 48		SAND+GRAVEL from 0' to 48	
Material and Depth Interval:	SANDY CLAY from 48' to 59		SANDY CLAY from 48' to 59	
Material and Depth Interval:	LIMESTONE from 59' to 122		LIMESTONE from 59' to 122	
Material and Depth Interval:	SANDSTONE from 122' to 500		SANDSTONE from 122' to	
Material and Depth Interval:	from ' to '		from ' to '	
Drillhole Diameter and Anticipated Depth Intervals:				
Diameter and Depth Interval:	16.0" from 0' to 140		16.0" from 0' to 80	
Diameter and Depth Interval:	15.0" from 140' to 500		15.0" from 80' to 600	
Diameter and Depth Interval:	from ' to '		from ' to '	
Permanent Casing or Liner Diameter and Wall Thickness at Anticipated Depth Intervals:				
Diameter and Wall Thickness at Depth Interval:	16.0" diam/ .375" thick 0' to 140		16.0" diam/ .375" thick 0' to 80	
Diameter and Wall Thickness at Depth Interval:	" diam/ " thick ' to '		" diam/ " thick ' to '	
Permanent Casing or Liner Material, If Used:				
Casing Joints (Welded, T and C, etc.)				
Material and Weight at Depth Interval:	STEEL 162.98 lbs/foot 0' to 140		STEEL 162.98 lbs/foot 0' to 80	
Material and Weight at Depth Interval:	/ lbs/foot ' to '		/ lbs/foot ' to '	
Screen Material, Slot Size in Inches and Depth Interval or N/A if none:	NA / " / ' to '		NA / " / ' to '	
Casing to Screen Joint (Welded, T and C, K Packer, etc.)	NA		NA	
Annular Space Material Including Filter Pack Material, If Used:				
Material and Depth Interval:	BENTONITE / 0' to 140		/ 0' to	
Material and Depth Interval:	/ ' to '		/ ' to '	
Proposed Average Water Usage Per Day in Gallons:	864,000 (600 GPM)		864,000 (600 GPM)	
Proposed Maximum Water Usage Per Day in Gallons:	1,728,000 (1200 GPM)		1,728,000 (1200 GPM)	
Seasonal? (April to October, Year Around, etc.):	APRIL TO OCTOBER		APRIL TO OCTOBER	
Proposed Pump Type & Capacity (gpm):	SUBMERSIBLE / 1200 GPM		SUBMERSIBLE / 1200 GPM	
Discharge Type (Over Top of Casing Seal, Pitless Adapter or Unit):	OVER TOP OF CASING		OVER TOP OF CASING	
Discharge Location (Building Pressure Tank, Pond, etc.):	IRRIGATION SYSTEM		IRRIGATION SYSTEM	
Distance and Direction to Nearest Public Utility Well & Well Name:	4 MILES SOUTH EAST, YAHARA ELEMENTARY SCHOOL B0269		3 MILES SOUTH EAST, YAHARA ELEMENTARY SCHOOL B0269	
Distance to Other Potential Contaminant Sources:	4 MILES SOUTH, TOWN OF PORTER LANDFILL.		3 MILES SOUTH, TOWN OF PORTER LANDFILL.	
Distance to Other Potential Contaminant Sources:				
Leave Blank, for Department use only				

Required Attachments

- Attach one of the maps described in A. or B., below. Plot the existing and proposed well locations on the map. For wells that have a Wisconsin Unique Well Number or a Permanent High Capacity Well Number, plot the well locations with one of those numbers.
 - Copy of a plat map with the property boundary clearly shown. If the property is contiguous with properties owned by the same owner in another township, include a copy of that township map too, showing the property boundaries. If the property owner listed on the plat map is different from the current owner, list the date or dates, that the current property owner purchased the property on the map.
 - Map of the property prepared by a licensed land surveyor and the property description as described by the surveyor.
- Sketch map showing all of the following that are planned or exist within 300 feet of each proposed well: proposed well location; other wells; property boundary; wetlands; potential contaminant sources (septic tank and drainfield, petroleum storage tanks, sewer lines, etc.); buildings and north arrow. If no pertinent features to map within 300 feet of the proposed well, for example an irrigation well in the middle of a field, state that on the property map listed above and plot the well locations on that map.
- Any well construction records available for existing wells on the property. Do not attach any well construction records for wells that are not on the property. If a Wisconsin Unique Well Number has not been assigned, write a well name or site well number on the record that correlates to the well name or number plotted on the maps.
- For proposed wells with a capacity greater than 400 gallons per minute, include the performance curve or performance table that is provided by the pump manufacturer. If the pump will be a lineshaft turbine, provide a curve with the same rpm as the motor under full load and list the motor horsepower.
- If more than one well is connected to a common plumbing system, also provide a schematic drawing of the system showing method of preventing backflow. This sketch must include the well discharge (pitless, over top of casing sanitary seal); the water line from the well; pressure tanks; sampling faucets; check valves; backflow preventers; air gaps; manually operated valves; water meters; pressure switches for pumps; and any other pertinent fittings. This schematic drawing must also identify which of these components are buried or above ground. If there is more than one check valve within the well casing, include in-well check valves on the schematic.
- If reconstruction of an existing well is proposed, include a diagram of the current well construction and a diagram of the proposed construction.
- If the application is for a high capacity well or wells, a \$500.00 check payable to the Department of Natural Resources, unless the application is only for continued operation after a change of ownership.

Certification and Applicant Signatures

If the application requests a variance for a well within 1,200 feet of a landfill, a well on a property with a groundwater use restriction, or any other variance to NR 812, Wis. Adm. Code, the property owner must sign the application. If the well operator will install a well on property that he or she does not own, the property owner must also sign the application. Otherwise, an agent of the owner may sign the application.

Unsigned and incomplete applications will not be approved.

By signing this form, the person signing this application certifies that to the best of his or her knowledge, all existing well installations on the property comply with ch. NR 812, Wis. Adm. Code. The person also certifies that to the best of his or her knowledge, all information in the application is accurate and correct.

Name - Print

JEFF KRAMER

Check Box

☐ Owner☒ Agent of the Owner

Signature

JEFF KRAMER

Company

SAM'S WELL DRILLING.

Date

2/19/14

Application submittal. Mail completed application and payment with all required attachments to DNR, Private Water Systems Section - DG/2, PO Box 7921, Madison WI 53707-7921.

Definitions from Wisconsin Administrative Codes

"High capacity well" means a well constructed on a high capacity property. [NR 812.07(51)]

"High capacity property" means one property on which a high capacity well system exists or is to be constructed. [NR 812.07(52)]

"High capacity well system" means one or more wells, drillholes or mine shafts used or to be used to withdraw water for any purpose on one property, if the total pumping or flowing capacity of all wells, drillholes or mine shafts on one property is 70 or more gallons per minute based on the pump curve at the lowest system pressure setting, or based on the flow rate. [NR 812.07(53)]

"Public water system" means a system for the provision to the public of piped water for human consumptions if such system has at least 15 service connections or regularly serves an average of at least 25 individuals daily at least 60 days per year. A public water system is either a community water system or a non-community water system. Such system includes: (a) Any collection, treatment, storage, and distribution facilities under control of the operator of such system and used primarily in connection with such system, and (b) Any collection or pretreatment storage facilities not under such control which are used primarily in connection with such system. [NR 812.07(80)]


"School" means a public or private educational facility in which a program of educational instruction is provided to children in any grade or grades from kindergarten through the 12th grade. Water systems serving athletic fields, school forests, environmental centers, home-based schools, day-care centers and Sunday schools are not school water systems. [NR 812.07(94)]

"Wastewater treatment plant" means any facility provided for the treatment of sanitary or industrial wastewater or both. The following types of facilities are excluded: (a) Facilities defined as private sewage systems in s. 145.01(12), Stats. (b) Pretreatment facilities from which effluent is directed to a public sewer system for treatment. (c) Industrial wastewater treatment facilities which consist solely of a land disposal system. [NR 114.03(14)]

PORTER

T.4N.-R.11E.

DANE COUNTY

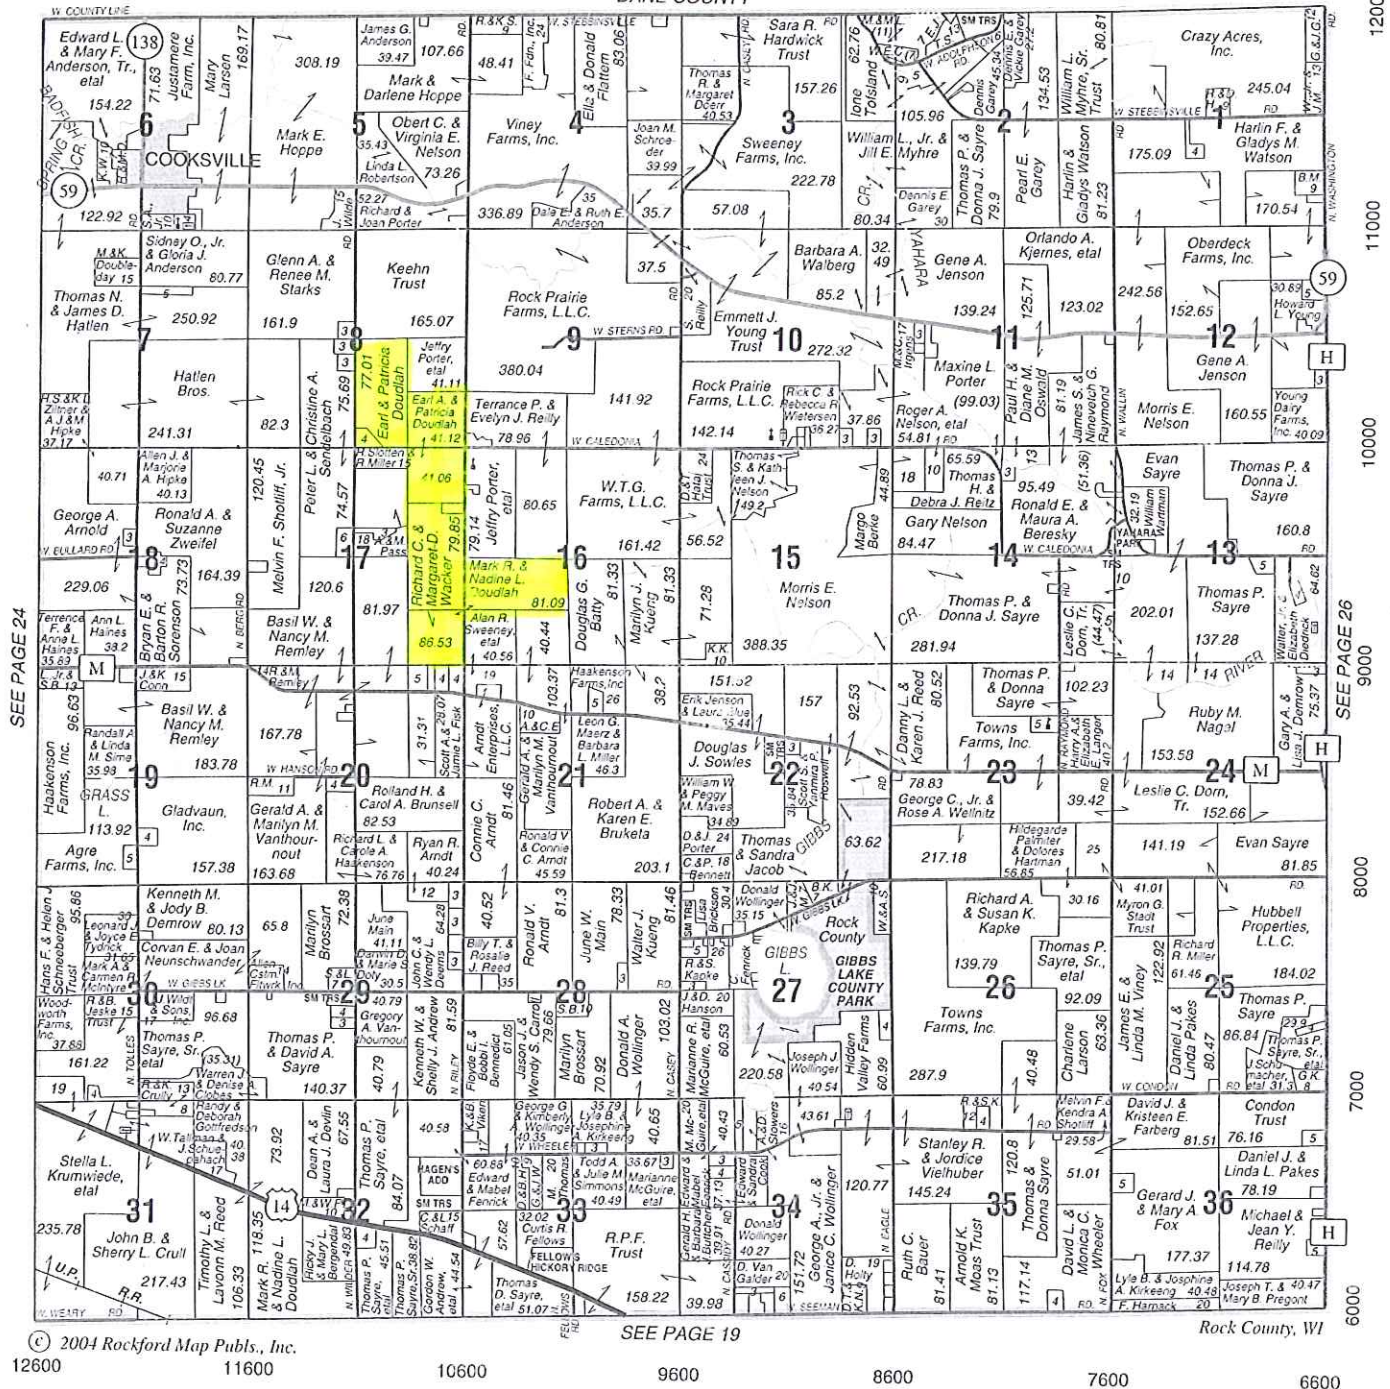

NELSON-YOUNG LUMBER COMPANY

QUALITY BUILDING MATERIALS
EXCELLENT SERVICE

Serving Southern Wisconsin and Northern Illinois For Over 80 Years

EDGERTON
(608) 884-3316

EVANSVILLE
(608) 882-4960

DEERFIELD
(608) 764-8608


PORTER



Rock Co.

T. 4 N. - R. 11 E.

25

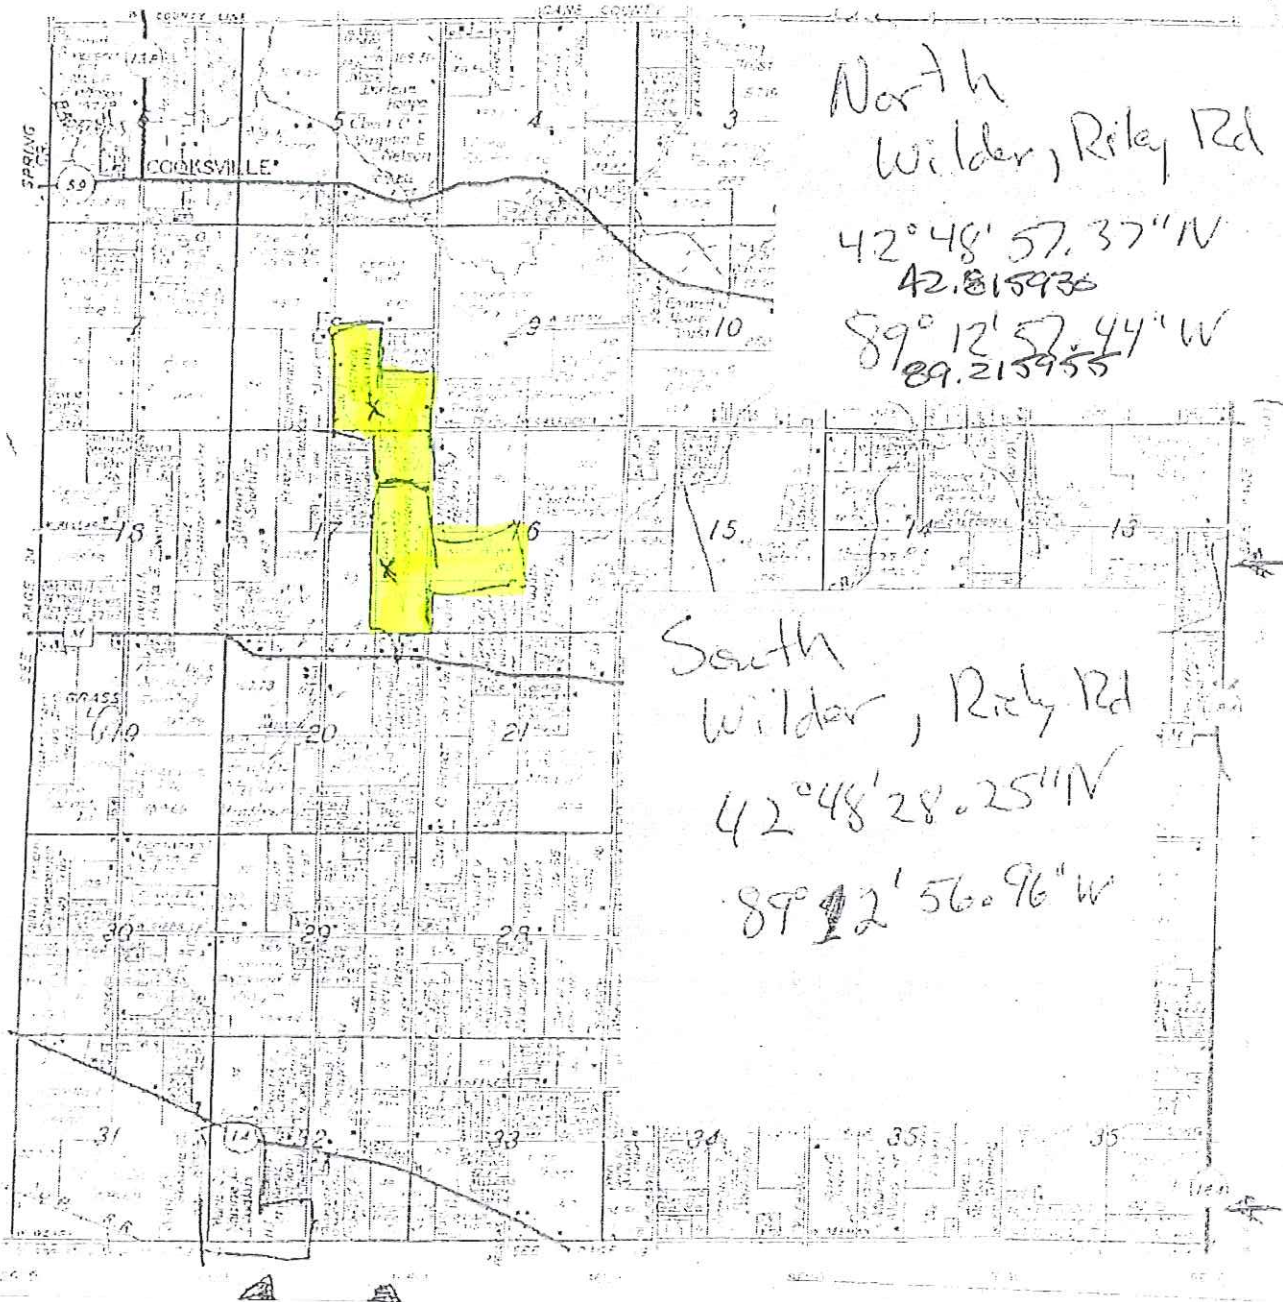

North
Wilder, Riley Rd

$42^{\circ}48'57.37''N$

42.815936

$89^{\circ}12'57.44''W$

89.215955

South
Wilder, Riley Rd

$42^{\circ}48'28.25''N$

$89^{\circ}12'56.96''W$